



ENG. FILE NAME: FIGURE\44\FUSEBLCK\REJCT\RJP-KJ

B1K0BTWZ37RKH

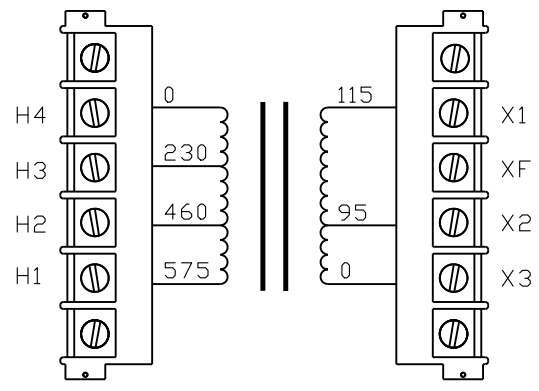

CONNECTION DIAGRAM

RATING: 1000VA 50/60HZ  
 PRI. 230/460/575 VOLTS  
 TRIPLE RATED  
 SEC. 95/115 VOLTS  
 TEMP.CLASS 180

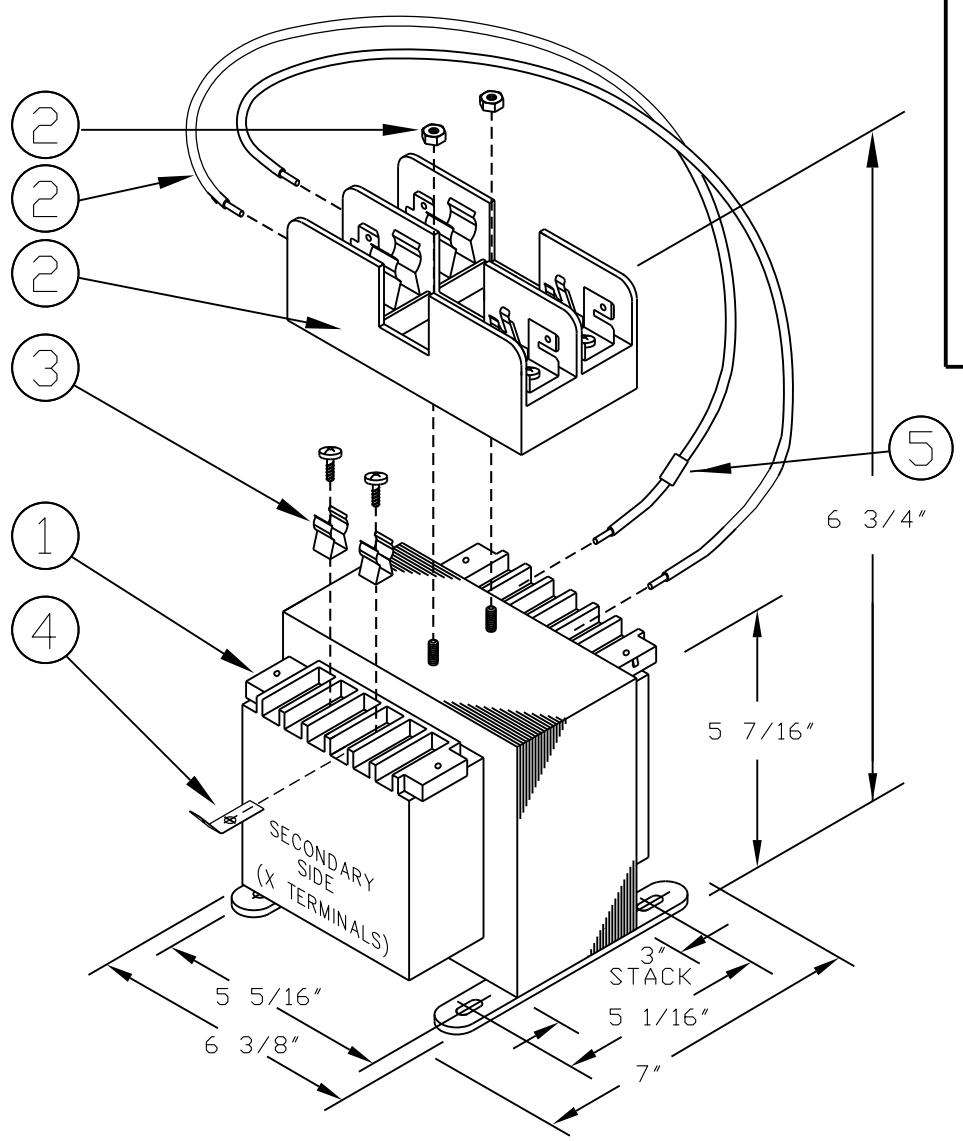

Assembly instructions: \_\_\_\_\_

FOR TEST REQUIREMENTS SEE COIL TEST PAGE: 419-0078

c	INSTALL FUSE BLOCK PER 361-0120
b	INSTALL FUSE CLIPS PER 361-0103
a	APPLY LABELS PER 361-0005
ASSEMBLY Instructions	
8	
7	
6	
5	LEAD MARKER "H"
4	QDC TERMINAL
3	TYPE "K" FUSE CLIPS W/JUMPER
2	REJECTION FUSEHOLDER KIT
1	BASE MODEL/COIL 619-0078/419-0078
IT	ITEM DESCRIPTION

TREATMENT:  
 IMPERV     VALU     ECON     GLOBAL  
 VACUUM IMPREGNANT, TYPE \_\_\_\_\_  
 OTHER \_\_\_\_\_

See BILL OF MATERIAL for ITEM  
 Quantity and Part Number

**MICRON** CONTROL TRANSFORMER  
 MICRON INDUSTRIES CORPORATION  
 1211 W. 22nd STREET, Suite 200, OAK BROOK, ILL.  
 Tel. (800)664-4660, (630)516-1222 Fax (630)516-1820  
 www.MicronPower.com

	DRAWING UPDATED	J.V	7/31/13	
	ADDED "H" MARKER LABEL	PJA	3/20/10	
B	DESIGN REVISED	AN002087	J.V	3/14/07
A	NEW		J.V	11/2/05
ECL	REVISIONS	BY	DATE	

DATE	11/2/05	DRAWN	J.G.V.	CHECKED		APPROVED	
RELEASE DATE		CUSTOMER PART NO.					
DRAWING NAME							
FINAL ASSEMBLY							
B1K0BTWZ37RKH							
SIZE	A	SCALE	NONE				